


1.450" PRINT DIAMETER

A ←

**NOTES:**

- 1) EFFECTIVE "H" IS ESTABLISHED BY SUBTRACTING GASKET THICKNESS FROM OVERALL "H"
- 2) MATERIALS USED MEET FDA REQUIREMENTS
- 3) 6TPI, .167 PITCH

1.02  
[25,9]

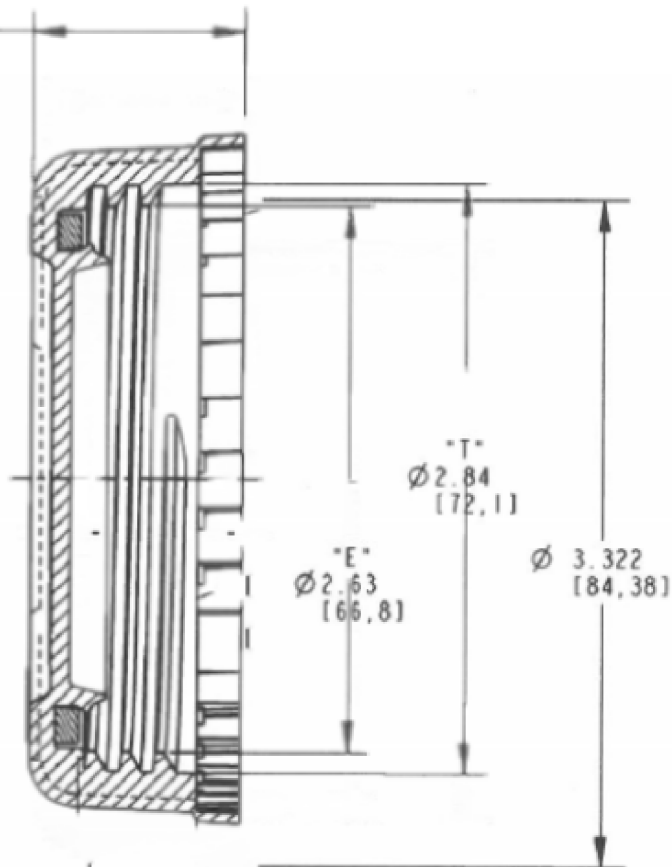

EFFECTIVE "H"  
.57  
[14,6]  
SEE NOTE #1

SECTION A-A



**Pipeline Packaging**

30310 Emerald Valley Pkwy  
Glenwillow, OH 44139

PPC ITEM NUMBER:  
99240

SKU:  
05-05-078-00004

DRAWN BY:  
-

CHECKED BY:  
-

DATE:  
3/20/2019

DESCRIPTION:  
70mm Tamper Evident HDPE Closure

COLOR:  
-

PART MATERIAL:  
-

VOLUME:  
-

WEIGHT:  
-

DWG NO.:

DWG SIZE:  
A

SHEET NO:  
1 of 1

REV:  
-

**PROPRIETARY AND CONFIDENTIAL**

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF PIPELINE PACKAGING. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF PIPELINE PACKAGING IS PROHIBITED.

**UNLESS OTHERWISE SPECIFIED:**

UNITS OF MEASURE: Inches

TOLERANCES: Specified in drawing